



Airport Services Center: 125 G Avenue • Gwinn, MI 49841 • www.sawyerairport.com

Airport Administrative Office (906) 346-3308 Water/Wastewater Department (906) 346-3137 Maintenance Department (906) 346-4336

## Notice to Bidders for Letting of April 30th, 2021

ADDENDUM NO. 1 – Issued April 13th, 2021


## SAWYER INTERNITONAL AIRPORT Fire Rescue Building Drainage Improvements

This Addendum provides additional information for potential bidders. Bidders are required to acknowledge receipt of this Addendum in the space provided on the Proposal forms.


## **ADDITIONAL INFORMATION**


- 1. It was questioned if the rubble/dirt created during construction will need to be hauled off-site or if there is a place on-site where this can be disposed of. *There is a site on airport property where this can be disposed of that will be shared with the chosen contractor.*
- 2. What size tank is required for this project? A minimum 800-gallon tank is required for the project.
- 3. Can the thickness of the concrete floor and rebar location/layout be shared? The thickness of the fire rescue building concrete flooring surrounding the drains is 8in. concrete slab on grade with rebar every 12in underneath. See attached foundation details.
- 4. It is a requirement to the project to caulk all concrete seams? *Yes.*

Addendum No. 1 Sawyer International Airport Fire Rescue Drainage Improvements Issued April 13<sup>th</sup>, 2021

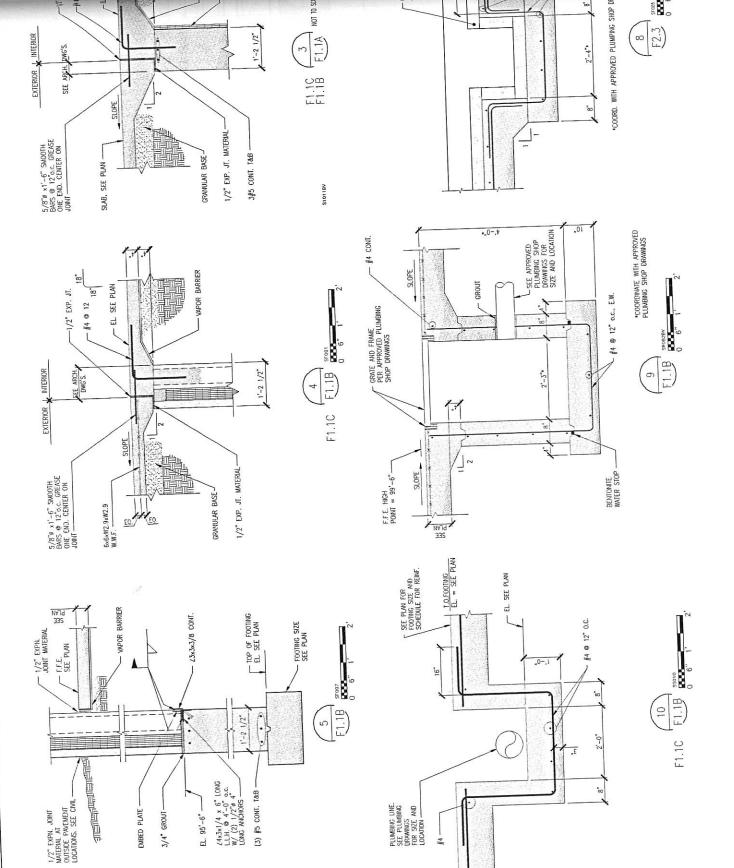


5.2

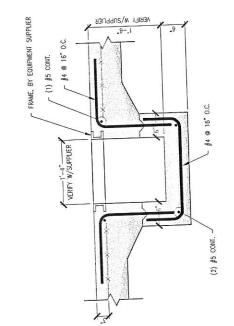





(F)





APPROVED PLUMPING SHOP


















-










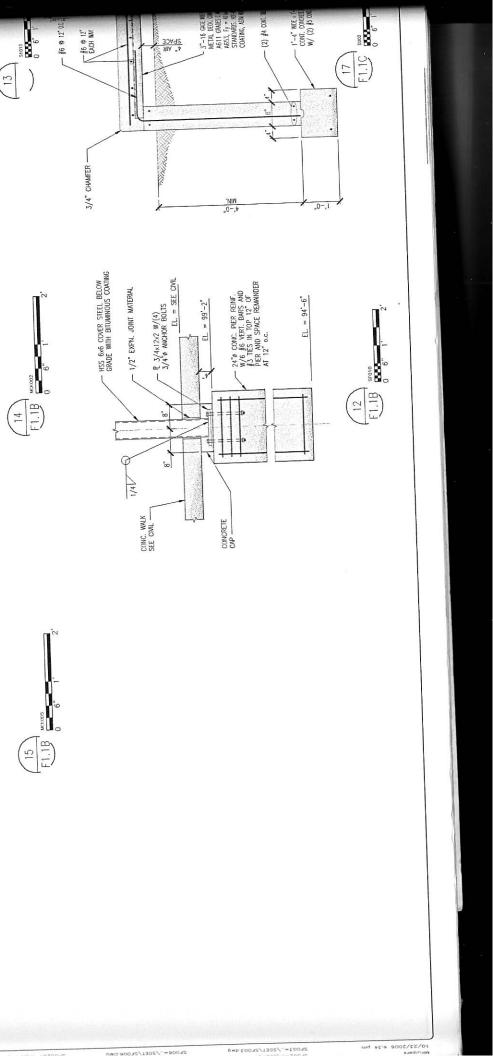

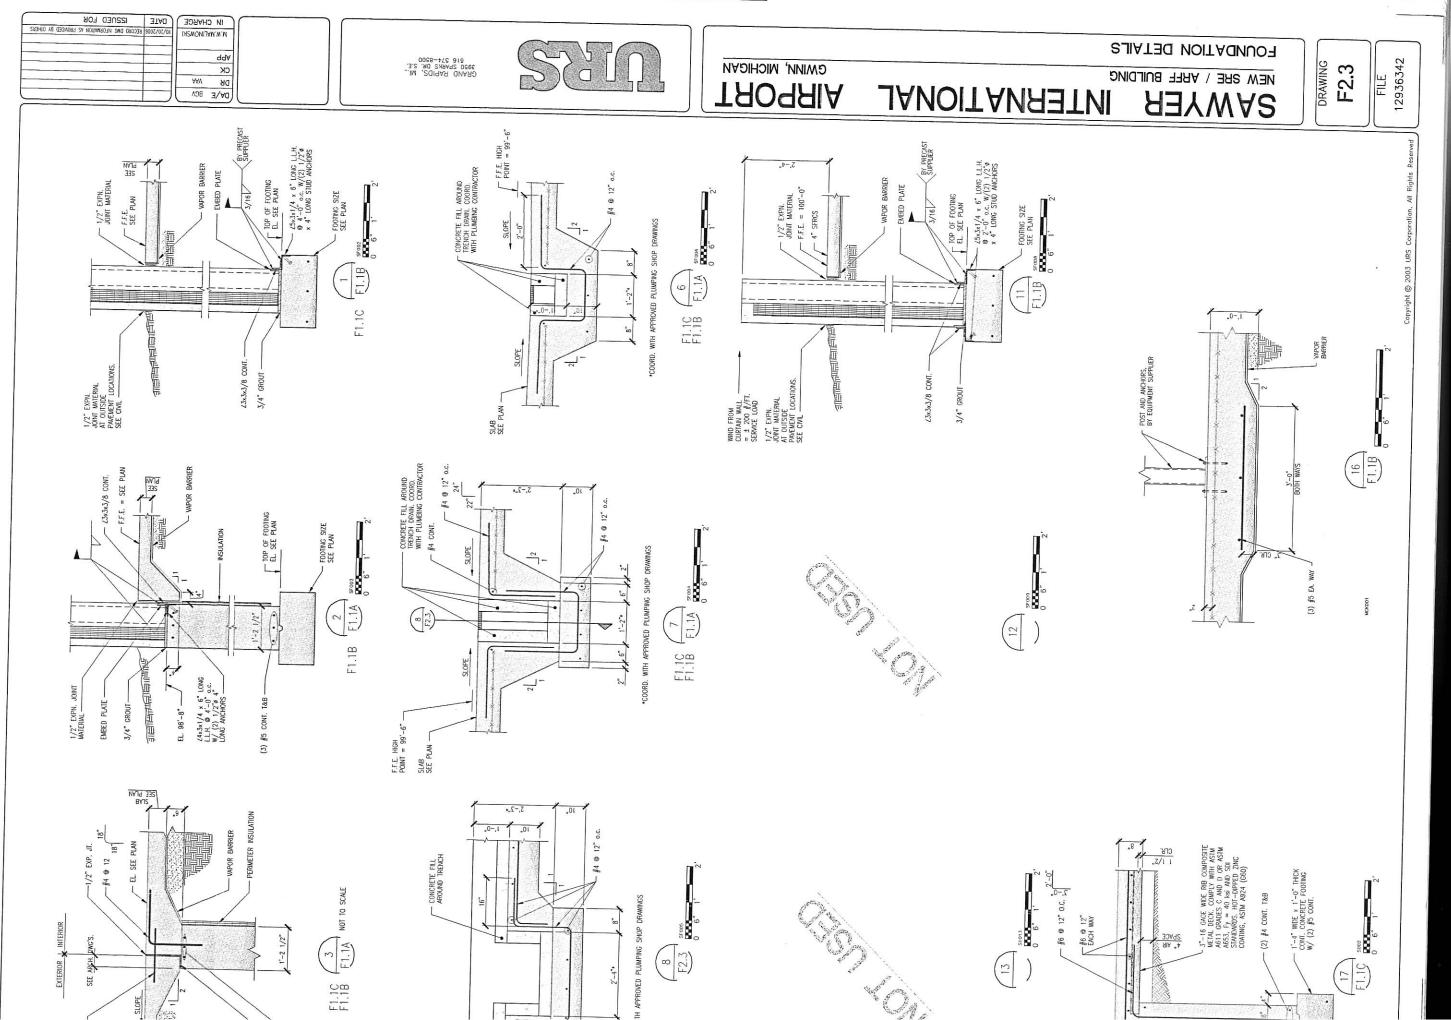

C & CONSULTANTS

SENED EOB